


Installation Example

Concrete Class A 15 - F 900

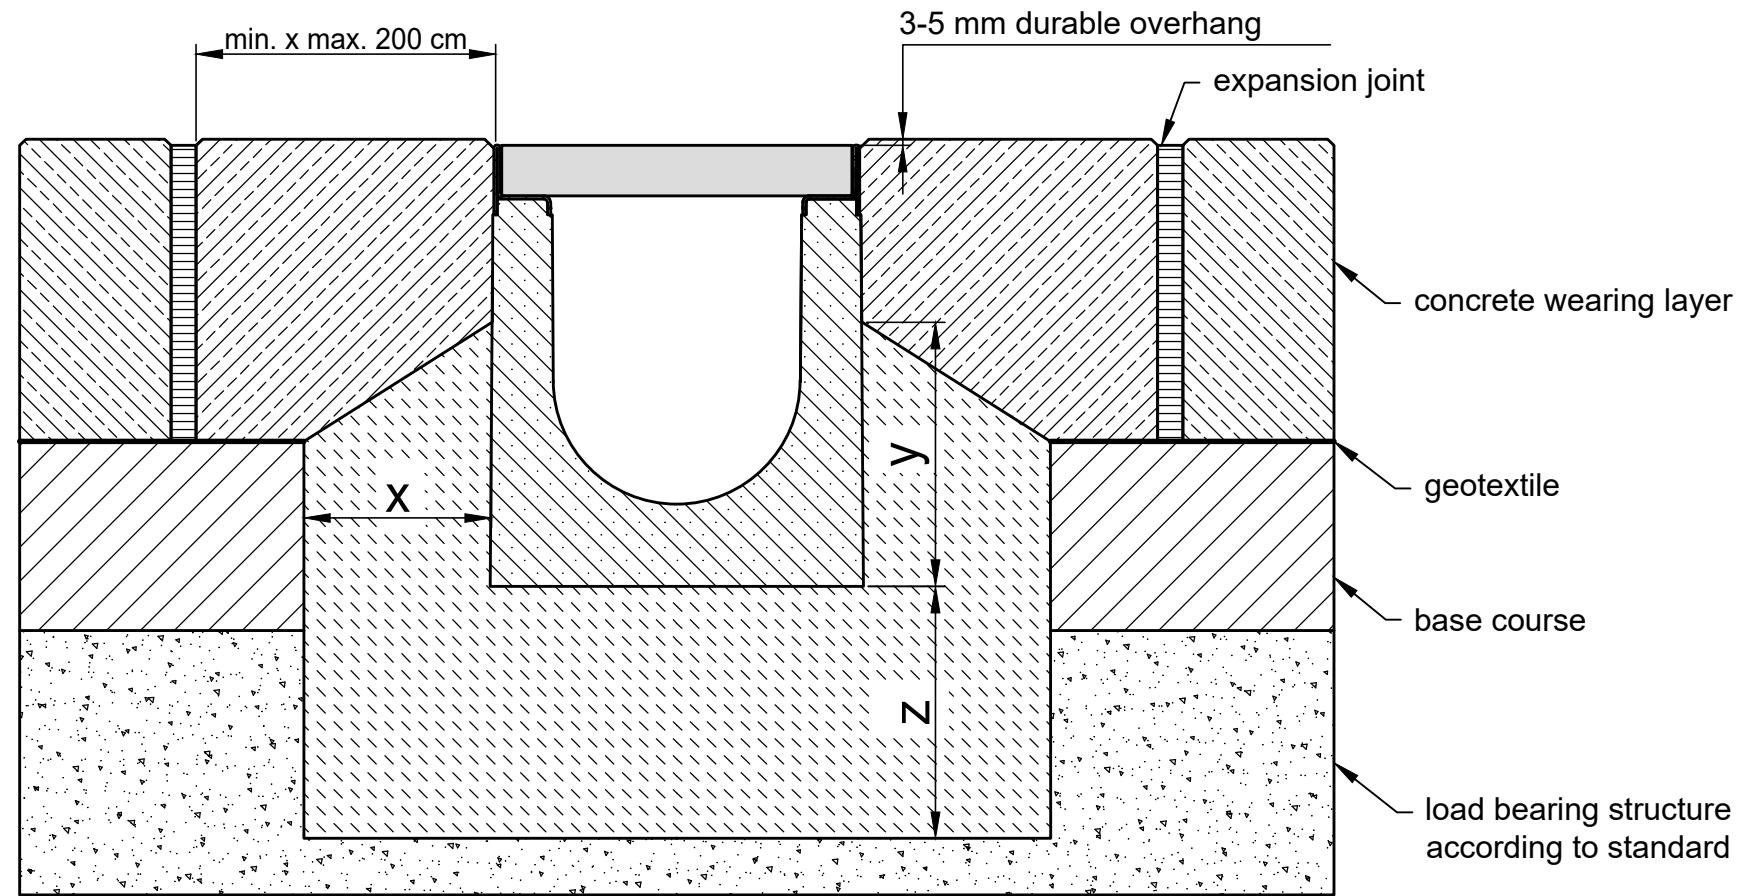

* $y \geq$ Channel height - 14 cm

Category according to EN 1433 / DIN 19580		A 15	B 125	C 250	D 400**	E 600**	F 900**	Applying to following systems: FASERFIX SUPER 100, 150, 200, 300, 400, 500 SERVICE CHANNEL FASERFIX SUPER 150, 200, 300, 400, 500		
Foundation: width x / height y / thickness z (in cm)		10 /* / 10	10 /* / 10	15 /* / 15	15 /* / 15	15 /* / 20	15 /* / 20			
EN 206-1 / DIN 1045-2 The named concrete quality is a minimum quality	quality of concrete stretcher									
	without danger of frost on the lateral support	C25/30 X0								
	with danger of frost on the lateral support	C25/30 XF3								
The installation examples / advise constantly are adapted to the technical conditions. With new editions older expenditures lose their validity. Before planning or installation please verify the current version at www.hauraton.com In building construction is a sealing layer below the channels necessary.								Date: 01.03.2023	Our general installation instructions apply.	
The installation example represents a proven recommendation from HAURATON. The final responsibility for the execution lies with the planner in charge. Specific conditions of the project must be taken into account.								Format DIN A4		
** Installation situations of drainage systems with high dynamic loads (e.g. airports, expressways and maneuvering areas of buses, trucks and forklifts, etc.) are not sufficiently considered in DIN EN 1433. Please contact us for such applications to work out project-specific solutions.								scale 1:6		
0000023712_ENGLISH.dwg								21	EBBw	
FF-S-200 Typ 010 Rinnenunterteil Einbaubeispiel Klasse E 600 in Beton								 hauraton Werkstr. 13 76437 Rastatt Germany		
Tel. +49 (0) 72 22 9 58-0										
info@hauraton.com										